

Allfasteners Pty Ltd  
78-84 Logistic Street  
Keilor Park, VIC 3042  
Australia

Eurofins Product Testing A/S  
Smedeskovvej 38  
8464 Galten  
Denmark

CustomerSupport@eurofins.com  
www.eurofins.com/VOC-testing

## VOC EMISSION TEST REPORT CDPH

2 September 2021

### 1 Sample Information

Sample name	Allfasteners VF18
Batch no.	129747
Production date	09/09/2019
Product type	Chemical anchor
Sample reception	20/11/2019

### 2 Brief Evaluation of the Results

Regulation or protocol	Conclusion	Version of regulation or protocol
CDPH	Pass	CDPH/EHLB/Standard Method V1.2. (January 2017)

Full details based on the testing and direct comparison with limit values are available in the following pages



Peter Alexander Skov  
Analytical Chemist, MSc. Eng. Chemistry



Janne Rothmann Norup  
Analytical Service Manager

## Table of contents

<b>1</b>	<b>Sample Information</b>	<b>1</b>
<b>2</b>	<b>Brief Evaluation of the Results</b>	<b>1</b>
<b>3</b>	<b>Applied Test Methods</b>	<b>3</b>
3.1	General Test References	3
3.2	Specific Laboratory Sampling and Analyses	3
<b>4</b>	<b>Test Parameters, Sample Preparation and Deviations</b>	<b>4</b>
4.1	VOC Emission Chamber Test Parameters	4
4.2	Preparation of the Test Specimen	4
4.3	Picture of Sample	4
4.4	Deviations from Referenced Protocols and Regulations	4
<b>5</b>	<b>Results</b>	<b>5</b>
5.1	VOC Emission Test Results after 11 Days	5
5.2	VOC Emission Test Results after 12 Days	5
5.3	VOC Emission Test Results after 14 Days	5
<b>6</b>	<b>Summary and Evaluation of the Results</b>	<b>6</b>
6.1	Comparison with Limit Values of CDPH	6
<b>7</b>	<b>Appendices</b>	<b>7</b>
7.1	Chromatogram of VOC Emissions after 14 Days	7
7.2	Chain of Custody	8
7.3	How to Understand the Results	9
7.4	Description of VOC Emission Test	10
7.5	Quality Assurance	11
7.6	Accreditation	11
7.7	Uncertainty of the Test Method	11

## 3 Applied Test Methods

### 3.1 General Test References

Regulation, protocol or standard	Version	Reporting limit VOC [ $\mu\text{g}/\text{m}^3$ ]	Calculation of TVOC	Combined uncertainty <sup>a</sup> [RSD(%)]
EN 16516	October 2017	5	Toluene equivalents	22%
ISO 16000 -3 -6 -9 -11	2006-2011 depending on part	2	Toluene equivalents	22%
ASTM D5116-10	2010	-	-	-
CDPH	CDPH/EHLB/Standard Method V1.2. (January 2017)	2	Toluene equivalents	22%

### 3.2 Specific Laboratory Sampling and Analyses

Procedure	External Method	Internal SOP	Quantification limit / sampling volume	Analytical principle	Uncertainty <sup>a</sup> [RSD(%)]
Sample preparation	ISO 16000-11:2006, EN16402:2013, CDPH:2017, AgBB:2018, EMICODE:2019	71M549810	-	-	-
Emission chamber testing	ISO 16000-9:2006, EN 16516:2017	71M549811	-	Chamber and air control	-
Sampling of VOC	ISO 16000-6:2011, EN 16516:2017	71M549812	5 L	Tenax TA	-
Analysis of VOC	ISO 16000-6:2011, EN 16516:2017	71M542808B	1 $\mu\text{g}/\text{m}^3$	ATD-GC/MS	10%
Sampling of aldehydes	ISO 16000-3:2011, EN 16516:2017	71M549812	35 L	DNPH	-
Analysis of aldehydes	ISO 16000-3:2011, EN 717-1:2004, EN 16516:2017	71M548400	3-6 $\mu\text{g}/\text{m}^3$	HPLC-UV	10%
Sampling on Charcoal tubes	ISO 16200-1:2001	71M546081	60 L	charcoal	-
Analysis of Charcoal tubes	ISO-16200-1:2001	71M546081	20 $\mu\text{g}/\text{m}^3$	Headspace-GC/MS	10%

## 4 Test Parameters, Sample Preparation and Deviations

### 4.1 VOC Emission Chamber Test Parameters

Parameter	Value	Parameter	Value
Chamber volume, V[L]	119	Preconditioning period	-
Air Change rate, n[h <sup>-1</sup> ]	0.5	Test period	16/12/2019 - 30/12/2019
Relative humidity of supply air, RH [%]	50 ± 3	Area specific ventilation rate, q [m/h or m <sup>3</sup> /m <sup>2</sup> /h]	71
Temperature of supply air, T [°C]	23 ± 1	Loading factor [m <sup>2</sup> /m <sup>3</sup> ]	0.007
		Test scenario	Very small area

### 4.2 Preparation of the Test Specimen

The sample was applied onto a glass plate using a dispenser gun and drawn off over a model giving a 3 mm thick and uniform layer with a broadness of 10 mm.

### 4.3 Picture of Sample



### 4.4 Deviations from Referenced Protocols and Regulations

The air change rate was 0.5/h (not 1.0/h) during testing; the results were calculated back to normative air exchange rates for class room and small office.

The loading factor was less than the lowest factor of 0.3 m<sup>2</sup>/m<sup>3</sup> that CDPH method specifies for testing; CDPH method does not specify a clear loading factor in any model room. Instead, the loading factor as specified in EN 16516 was applied both during testing and for calculation of the air concentration in office and classroom.

## 5 Results

### 5.1 VOC Emission Test Results after 11 Days

	CAS No.	Specific Conc. [µg/m³]	Specific SER [µg/(m²·h)]	Toluene eq. [µg/m³]	Toluene SER [µg/(m²·h)]
<b>TVOC (C5-C17)tol. eq.</b>				31	2200
<b>Aldehydes</b>					
Formaldehyde	50-00-0	< 3	< 300		
Acetaldehyde	75-07-0	< 3	< 300		

### 5.2 VOC Emission Test Results after 12 Days

	CAS No.	Specific Conc. [µg/m³]	Specific SER [µg/(m²·h)]	Toluene eq. [µg/m³]	Toluene SER [µg/(m²·h)]
<b>TVOC (C5-C17)tol. eq.</b>				32	2300
<b>Aldehydes</b>					
Formaldehyde	50-00-0	< 3	< 300		
Acetaldehyde	75-07-0	< 3	< 300		

### 5.3 VOC Emission Test Results after 14 Days

	CAS No.	Retention time [min]	ID-Cat	SER [µg/(m²·h)]	Classroom Conc. [µg/m³]	Office Conc. [µg/m³]	½ CREL [µg/m³]
<b>VOC (C5-C17)</b>							
Acetic acid * a	64-19-7	1.86	1	1700	15	1.7	
Hexanal	66-25-1	4.79	1	160	1.4	0.2	
Methylstyrene *	1319-73-9	8.48	1	1300	11	1.3	
<b>TVOC (C5-C17)tol. eq.</b>				1900	16	2.0	
<b>Aldehydes</b>							
Formaldehyde	50-00-0		1	< 300	< 3	< 1	9
Acetaldehyde	75-07-0		1	< 300	< 3	< 1	70

The results are only valid for the tested sample(s).

This report may only be copied or reprinted in its entirety, parts of it only with a written acceptance by Eurofins.

## 6 Summary and Evaluation of the Results

### 6.1 Comparison with Limit Values of CDPH

Parameter	Test after 14 days			
	CAS No.  Single compounds	Concentration in Classroom [µg/m³]	Concentration in Office Room [µg/m³]	½ CREL [µg/m³]
TVOC (C5-C17)tol. eq.	-	13	2.0	-
<b>Single compounds</b> (with defined CREL values)				
None determined	-	-	-	-
<b>Formaldehyde</b>	50-00-0	< 3	< 1	≤ 9
<b>Acetaldehyde</b>	75-07-0	< 3	< 1	≤ 70

#### 6.1.1 Conversion of Emission Rates to CDPH Reference Room Concentrations

The CDPH method requires calculation of the measured emission rates into concentrations in given reference rooms. The equation and parameters figured below have been applied to calculate the concentrations in an office room or a classroom as required in the CDPH. The area used in the calculation varies depending on the expected usage of the product and therefore several entries can be found. Small and Very Small areas are not provided within the CDPH but are adapted from definitions given in EN 16516 and ISO 16000-9.

$$C_{\text{Calculated}} = \frac{SER_A \cdot A}{n \cdot V}$$

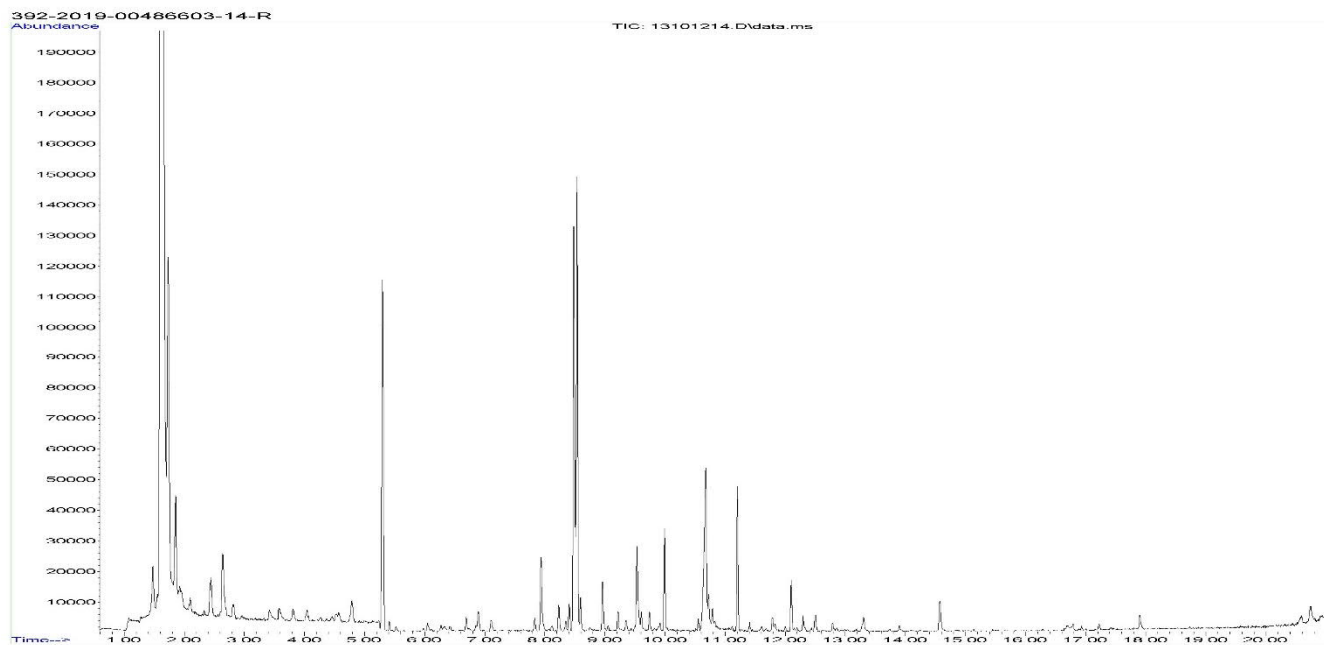
		Classroom parameters	Office Room parameters
SER	Area specific emission rate, µg/(m²h)	As tested	As tested
n	Air change, h <sup>-1</sup>	0.82	0.68
V	Volume of reference room, m³	231	30.6
A	Floor area, m²	89.2	11.1
	Walls area, m²	94.3	33.4
	Ceiling and Wall, m²	183.8	N/A
	Door and Millwork, m²	1.89	1.89
	Desk or Chair, units	27	1
	Very Small areas, m²	1.62	0.021
	Small areas, m²	11.55	1.53

The results are only valid for the tested sample(s).

This report may only be copied or reprinted in its entirety, parts of it only with a written acceptance by Eurofins.




## 7 Appendices

### 7.1 Chromatogram of VOC Emissions after 14 Days





## 7.2 Chain of Custody

Name of the product: 2KPS VESF		Type of product: Multipurpose Construction Adhesive	
Model / Program / Series: N/A		Batch N°.: 129747	
Article N°.: BPI076 Misc.		Date of batch production: 09/09/19	
Name of the manufacturer at the place of sampling (address / stamp): 2K Polymer Systems Venture Crescent DE55 7RA		Manufacturer (if deviating from company's name at the place of sampling):	
Sample collector (Name, company, telephone): Matthew Kearns, 2K Polymer Systems, +44 (0) 1773 527 476		Signature of sample collector: 	
Sample is taken from <input type="checkbox"/> the ongoing production <input checked="" type="checkbox"/> stocks		Date of sampling: 29/10/19	
Number of Samples 1		Time: 09:15	
Where had the product been stored prior to sampling?	<input type="checkbox"/> Production <input checked="" type="checkbox"/> Store <input type="checkbox"/> Miscellaneous	How had the product been stored prior to sampling?	<input type="checkbox"/> open <input checked="" type="checkbox"/> in the stack <input type="checkbox"/> wrapped up
Place of storage: Warehouse Storage		Packing material: Cartridge in open-lidded box	
Further links in chain of custody (Name, function, company, telephone)		Signature	
Further links in chain of custody (Name, function, company, telephone) BRIAN PHELPS, QHSSE MANAGER, 2K POLYMER SYSTEMS, 01773 527491		Signature 	
Sample sender (Name, company, telephone): Jane Stanford, 2K Polymer Systems, +44 (0) 1773 527 412		Signature of sample sender: 	
Date and time of sending: Tuesday 19 <sup>th</sup> November. 2:30pm		Shipment details/Carrier: Ref: E8916139/3KEG946056 DHL	
Where had the product sample been stored prior to sending?	<input type="checkbox"/> Production <input type="checkbox"/> Store <input checked="" type="checkbox"/> Miscellaneous	How had the product sample been stored prior to sending?	<input type="checkbox"/> open <input type="checkbox"/> in the stack <input checked="" type="checkbox"/> wrapped up
Place of storage: Sales Office		Packing material: Boxed in Sales Office	
Laboratory receiving details (date, condition of package and sample, assigned lab no.):			
Receptionist, Eurofins Product Testing A/S:		Signature of receptionist:	

The results are only valid for the tested sample(s).

This report may only be copied or reprinted in its entirety, parts of it only with a written acceptance by Eurofins.



## 7.3 How to Understand the Results

### 7.3.1 Acronyms Used in the Report

- < Means less than
  - > Means bigger than
  - \* Not a part of our accreditation
  - ⌘ Please see section regarding uncertainty in the Appendices.
  - § Deviation from method. Please see deviation section
  - a The method is not optimal for very volatile compounds. For these substances smaller results and a higher measurement uncertainty cannot be ruled out.
  - b The component originates from the substrate and is thus removed.
  - c The results have been corrected by the emission from wooden panels.
  - d Very polar organic compounds are not suitable for reliable quantification using tenax TA adsorbent and HP-5 GC column. A high degree of uncertainty must be expected.
  - e The component may be overestimated due to contribution from the system
- SER Specific Emission Rate.

### 7.3.2 Explanation of ID Category

#### Categories of Identity:

- 1: Identified by comparison with a mass spectrum obtained from library and supported by other information and quantified through specific calibration.
- 2: Identified by comparison with a mass spectrum obtained from library and supported by other information. Quantified as toluene equivalent.
- 3: Identified with a lower match by comparison with a mass spectrum obtained from a library. Quantified as toluene equivalent.
- 4: Not identified, quantified as toluene equivalent.

## 7.4 Description of VOC Emission Test

### 7.4.1 Test Chamber

The test chamber is made of stainless steel. A multi-step air clean-up is performed before loading the chamber, and a blank check of the empty chamber is performed.

The chamber operation parameters are as described in the test method section. (EN 16516, ISO 16000-9, internal method no.: 71M549811).

### 7.4.2 Expression of the Test Results

All test results are calculated as specific emission rate, and as extrapolated air concentration in the European Reference Room (EN 16516, AgBB, EMICODE, M1 and Indoor Air Comfort).

### 7.4.3 Testing of Carcinogenic VOCs

The emission of carcinogens (EU Categories C1A and C1B, as per European law) is tested by drawing sample air from the test chamber outlet through Tenax TA tubes after the specified duration of storage in the ventilated test chamber. Analysis is performed by ATD-GC/MS (automated thermal desorption coupled with gas chromatography and mass spectroscopy using 30 m HP-5 (slightly polar) column with 0.25 mm ID and 0.25 µm film, Agilent) (EN 16516, ISO 16000-6, internal methods no.: 71M549812 / 71M542808B).

All identified carcinogenic VOCs are listed; if a carcinogenic VOC is not listed then it has not been detected. Quantification is performed using the TIC signal and authentic response factors, or the relative response factors relative to toluene for the individual compounds.

This test only covers substances that can be adsorbed on Tenax TA and can be thermally desorbed. If other emissions occur, then these substances cannot be detected (or with limited reliability only).

### 7.4.4 Testing of VOC

The emissions of volatile organic compounds are tested by drawing sample air from the test chamber outlet through Tenax TA tubes after the specified duration of storage in the ventilated test chamber. Analysis is performed by ATD-GC/MS using HP-5 column (30 m, 0.25mm ID, 0.25µm film).

This test only covers substances which can be adsorbed on Tenax TA and can be thermally desorbed. If emissions of substances outside these specifications occur then these substances cannot be detected (or with limited reliability only).

### 7.4.5 Testing of Aldehydes

The presence of aldehydes is tested by drawing air samples from the test chamber outlet through DNPH-coated silicagel tubes after the specified duration of storage in the ventilated test chamber. Analysis is performed by solvent desorption and subsequently by HPLC and UV-/diode array detection.

The absence of formaldehyde and other aldehydes is stated if UV detector response at the specific wavelength is lacking at the specific retention time in the chromatogram. Otherwise it is checked whether the reporting limit is exceeded. In this case the identity is finally checked by comparing full scan sample UV spectra with full scan standard UV spectra.

### 7.4.6 Testing of Charcoal tubes

The presence of low boiling VOC is tested by drawing air samples from the test chamber outlet through charcoal tubes after the specified duration of storage in the ventilated test chamber. Analysis is performed by solvent desorption and subsequently by HS-GC/MS using a stabilwax column. This test only covers substances which has a CREL value and are not possible to sample on Tenax tubes.

## 7.5 Quality Assurance

Before loading the test chamber, a blank check of the empty chamber is performed and compliance with background concentrations in accordance with EN 16516 / ISO 16000-9 is determined.

Air sampling at the chamber outlet and subsequent analysis is performed in duplicate. Relative humidity, temperature and air change rate in the chambers is logged every 5 minutes and checked daily. A double determination is performed on random samples at a regular interval and results are registered in a control chart to ensure the uncertainty and reproducibility of the method.

The stability of the analytical system is checked by a general function test of device and column, and by use of control charts for monitoring the response of individual substances prior to each analytical sequence.

## 7.6 Accreditation

The testing methods described above are accredited on line with EN ISO/IEC 17025 by DANAK (no. 522). This accreditation is valid worldwide due to mutual approvals of the national accreditation bodies (ILAC/IAF, see also [www.eurofins.com/galten.aspx#accreditation](http://www.eurofins.com/galten.aspx#accreditation)).

Not all parameters are covered by this accreditation. The accreditation does not cover parameters marked with an asterisk (\*), however analysis of these parameters is conducted at the same level of quality as for the accredited parameters.

## 7.7 Uncertainty of the Test Method

The relative standard deviation of the overall analysis is 22%. The expanded uncertainty  $U_m$  equals  $2 \times RSD$ . For further information please visit [www.eurofins.dk/uncertainty](http://www.eurofins.dk/uncertainty).