

X-SERIES CONCRETE SCREW ANCHORS ZINC PLATED / A4 STAINLESS STEEL

ZP


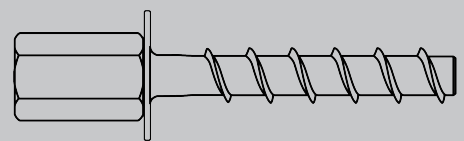
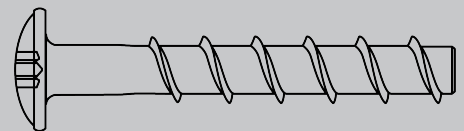
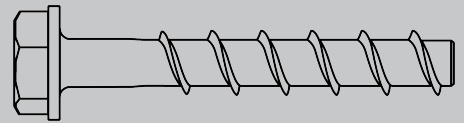
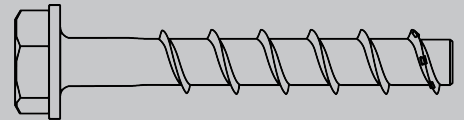
316

APPROVAL DOC

TDS

ETA-16/0204

27 November 2020



NCC Compliant AS 5216

This ETA document meets anchor testing and reporting requirements of AS 5216, essential for compliance with the NCC.



For Technical & Engineering Support engineering@allfasteners.com.au | +61 3 9330 0555

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-16/0204
of 27 November 2020

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

Concrete screw BSZ

Product family
to which the construction product belongs

Mechanical fasteners for use in concrete

Manufacturer

MKT
Metall-Kunststoff-Technik GmbH & Co. KG
Auf dem Immel 2
67685 Weilerbach
DEUTSCHLAND

Manufacturing plant

MKT Werk 5, D

This European Technical Assessment
contains

19 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330011-00-0601, Edition 07/2014 and
EAD 330232-00-0601, Edition 10/2016

This version replaces

ETA-16/0204 issued on 19 May 2020

European Technical Assessment

ETA-16/0204

English translation prepared by DIBt

Page 2 of 19 | 27 November 2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The Concrete screw BSZ is an anchor in size 6, 8, 10, 12 and 14 mm made of galvanised steel respectively steel with zinc flake coating, made of stainless or high corrosion resistant steel. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

Product and product description are given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B2 and C1
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C1
Displacements and Durability	See Annex C6 and Annex B1
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex A3, C2, C3, C4 and C7

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C5

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Documents EAD No. 330011-00-0601 and EAD No. 330232-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

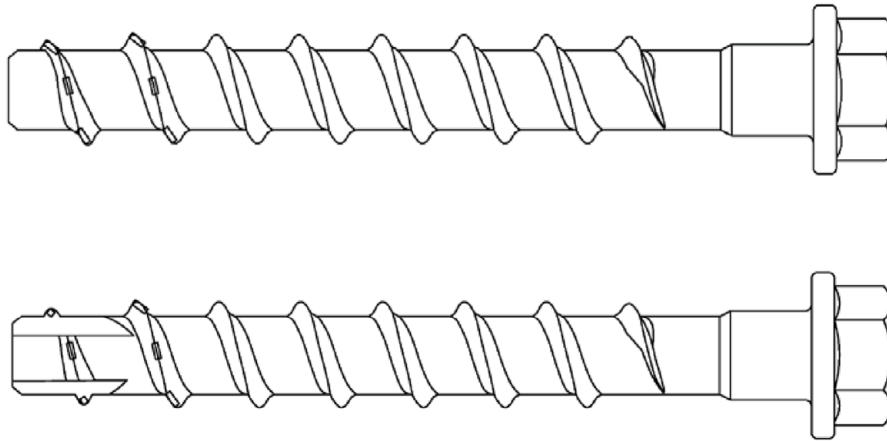
Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 27 November 2020 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Baderschneider

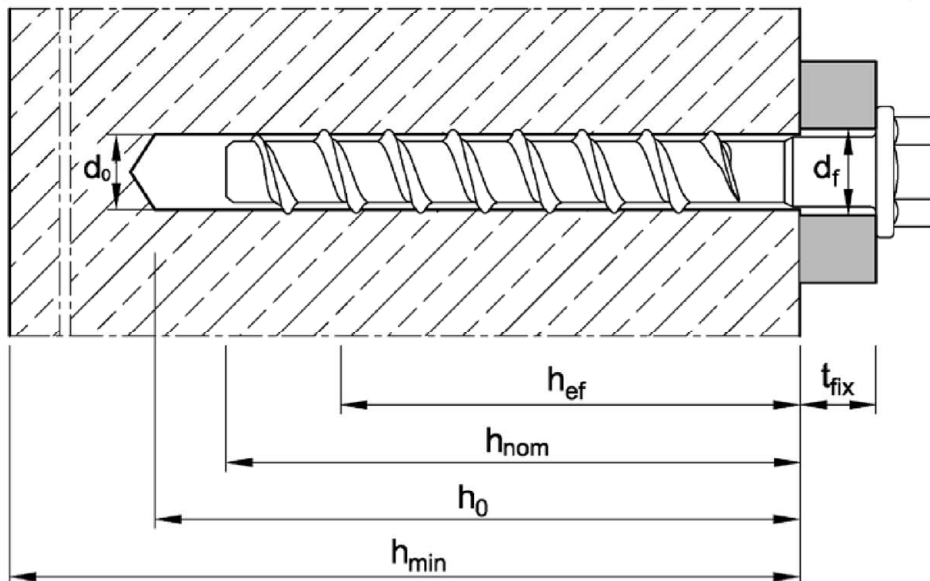
Concrete Screw BSZ



BSZ zinc plated
BSZ A4
BSZ HCR

Installation situation in concrete

(e.g. Concrete Screw BSZ with hexagon head and pressed-on washer)















- d_0 = nominal drill bit diameter
- h_{ef} = effective anchorage depth
- h_{nom} = nominal embedment depth
- h_0 = depth of the drill hole
- h_{min} = minimum thickness of member
- t_{fix} = thickness of fixture
- d_f = diameter of clearance hole in the fixture

Concrete Screw BSZ

Product description
Product and installation situation

Annex A1

Table A1: Anchor types and description

Anchor types			BSZ -	Description
1			BI	Anchor version with metric connection thread and hexagon socket
2			B	Anchor version with metric connection thread and hexagon drive
3			SU...TX	Anchor version with hexagon head, pressed-on washer and TORX drive
4			SU	Anchor version with hexagon head and pressed-on washer
5			SUB	Anchor version with hexagon head and collar
6			S	Anchor version with hexagon head
7			SK	Anchor version with countersunk head and TORX drive
8			LK	Anchor version with pan head and TORX drive
9			GLK	Anchor version with large pan head and TORX drive
10			BSK	Anchor version with countersunk head and metric connection thread
11			BS	Anchor version with hexagon drive and metric connection thread
12			M	Anchor version with internal thread and hexagon drive

Concrete Screw BSZ

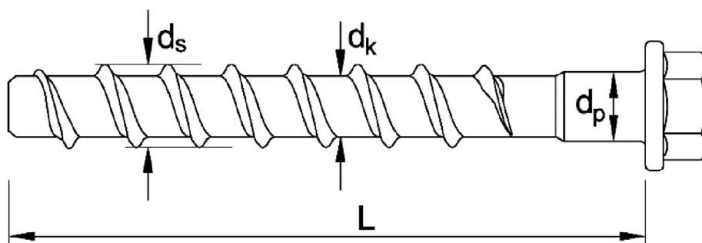
Product description
Anchor types and description

Annex A2

Table A2: Dimensions

Anchor size			BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth	h_{nom}	[mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Length of the anchor	$L \leq$	[mm]	500													
Core diameter	d_k	[mm]	5,1		7,1			9,1			11,1			13,1		
Outside diameter	d_s	[mm]	7,5		10,6			12,6			14,6			16,6		
Shaft diameter	d_p	[mm]	5,7		7,9			9,9			11,7			13,7		

Marking e.g.: \diamond BSZ 10 100
or TSM 10 100



\diamond BSZ Trade name
(optional with manufacturer
identification \diamond)
or TSM
10 Anchor size
100 Length of anchor

additional marking:

A4 stainless steel
HCR high corrosion resistant steel
BC ST version with hexagon head
and collar

Table A3: Materials

Version	Steel, zinc plated BSZ	Stainless steel BSZ A4	High corrosion resistant steel BSZ HCR
Material	Steel EN 10263-4:2017 galvanized acc. to EN ISO 4042:2018 or zinc flake coating acc. to EN ISO 10683:2018 ($\geq 5\mu\text{m}$)	1.4401, 1.4404, 1.4571, 1.4578	1.4529
Nominal characteristic steel yield strength f_{yk}	560 N/mm ²		
Nominal characteristic steel ultimate strength f_{uk}	700 N/mm ²		
Elongation at fracture A_s	$\leq 8\%$		

Concrete Screw BSZ

Product description
Dimensions, marking and materials

Annex A3

Specifications of Intended use

Concrete screw BSZ		BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth h_{nom} [mm]		40	55	45	55	65	55	75	85	65	85	100	75	100	115
Anchorage subject to	Static or quasi-static loading	✓													
	Fire exposure	✓													
	Seismic action C1	✓		-		✓	✓	-	✓	-	✓		-		✓
	Seismic action C2, BSZ zinc plated	-		-		✓	-	-	✓	-	✓		-		✓
Base material	Cracked or uncracked concrete	✓													
	Reinforced or unreinforced concrete (without fibres) acc. to EN 206:2013	✓													
	Strength classes according to EN 206:2013: C20/25 to C50/60	✓													

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc plated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)

Note: Particular aggressive conditions are e.g. permanent, alternation immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where deicing materials are used)

Design:

- Anchorage are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.)
- Design method of anchorages according to EN 1992-4:2018 and EOTA Technical Report TR 055.

Installation:

- Making of drill hole by hammer drilling (all sizes) or vacuum drill bit (BSZ 8 – BSZ 14). When using a vacuum drill bit no drill hole cleaning is required.
- Anchor installation carried out by appropriately qualified personal and under the responsibility of the person responsible for technical matters on site.
- After installation further turning of the anchor is not possible. The head of the anchor is supported on the fixture and is not damaged.
- The borehole may be filled with the Injection Systems VME or VME plus.
- Adjustment according to Annex B5: for concrete screw BSZ 8 to BSZ 14, all anchorage depths

Concrete Screw BSZ

Intended use
Specifications

Annex B1

Table B1: Installation parameters

Anchor size		BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth	h_{nom} [mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Nominal drill bit diameter	d_0 [mm]	6		8			10			12			14		
Cutting diameter of drill bit	$d_{cut} \leq$ [mm]	6,40		8,45			10,45			12,50			14,50		
Effective anchorage depth	h_{ef} [mm]	31	44	35	43	52	43	60	68	50	67	80	58	79	92
Depth of drill hole	$h_0 \geq$ [mm]	45	60	55	65	75	65	85	95	75	95	110	85	110	125
Diameter of clearance hole in the fixture	$d_f \leq$ [mm]	8		12			14			16			18		
Max. installation torque for screws with metric connection thread	$T_{inst} \leq$ [Nm]	10		20			40			60			80		
Tangential impact screw driver ¹⁾	$T_{imp,max}$ [Nm]	160		300			400			650			650		

¹⁾ Installation with tangential impact screw driver, with maximum power output $T_{imp,max}$ acc. to manufacturer's instructions is possible

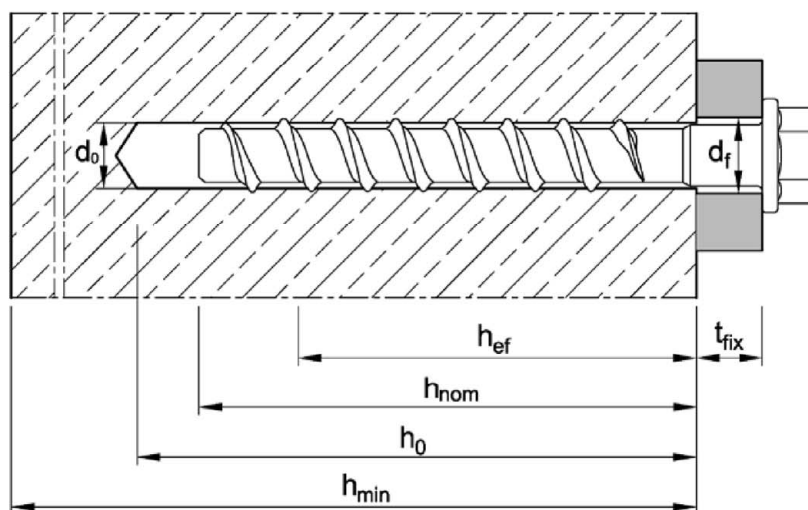


Table B2: Minimum thickness of member, minimum edge distance and minimum spacing

Anchor size		BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth	h_{nom} [mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Minimum thickness of member	h_{min} [mm]	80		80			80	90	102	80	101	120	87	119	138
Minimum spacing	s_{min} [mm]	40		40	50		50			50		70	50	70	
Minimum edge distance	c_{min} [mm]	40		40	50		50			50		70	50	70	

Concrete Screw BSZ

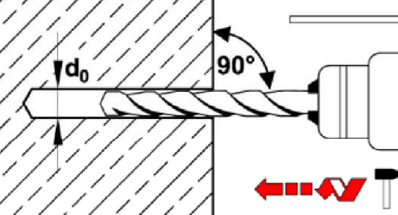
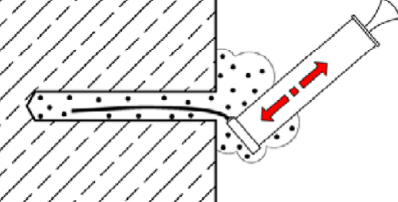
Intended use

Installation parameters / Minimum thickness of concrete member, minimum spacing and edge distance

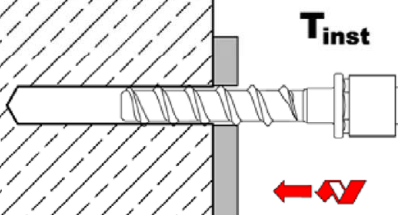
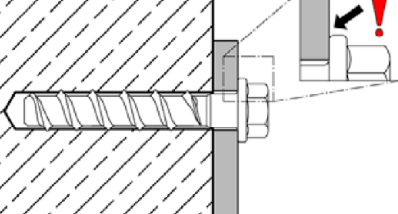
Annex B2

Installation instructions

Drill hole preparation and cleaning

1		<p>Drill hole perpendicular to concrete surface. Using a vacuum drill, continue with step 3.</p>
2		<p>Blow out dust or alternatively vacuum clean down to the bottom of the hole.</p>

Installation concrete screw

3		<p>Screw in, e.g. with tangential impact screw driver or torque wrench.</p>
4		<p>After installation, the head of the anchor is supported on the fixture and must be undamaged.</p>

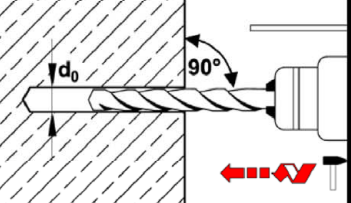
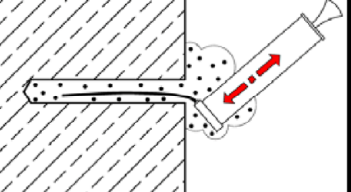
Concrete Screw BSZ

Intended use
Installation instructions

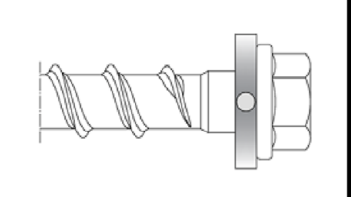
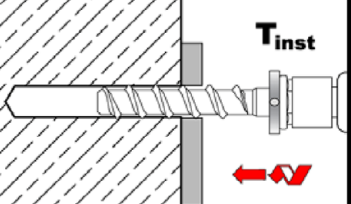
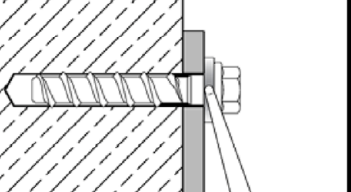
Annex B3

Installation instructions - filling of annular gap

Drill hole preparation and cleaning


1		Drill hole perpendicular to concrete surface. Using a vacuum drill, continue with step 3.
2		Blow out dust or alternatively vacuum clean down to the bottom of the hole.

Installation concrete screw with filling washer


3		Fit the filling washer to the concrete screw. The thickness of the filling washer must be taken into account with t_{fix} .
4		Screw in, e.g. with tangential impact screw driver or torque wrench.
5		Fill the annular gap between concrete screw and fixture with mortar (compressive strength $\geq 40 \text{ N/mm}^2$, e.g. Injection mortar VMH, VMZ or VMU plus). Use enclosed reducing adapter. Observe information on processing of the mortar! The annular gap is completely filled, when excess mortar seeps out.

For seismic loading, the application with and without filling of annular gap is permitted (Annex C3-C4).

Filling washer and reducing adapter for filling the annular gap between concrete screw and fixture



thickness of filling washer
 $t = 5 \text{ mm}$



Concrete Screw BSZ

Intended use

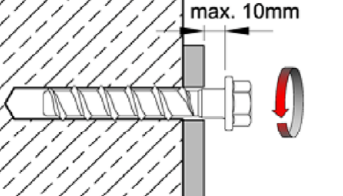
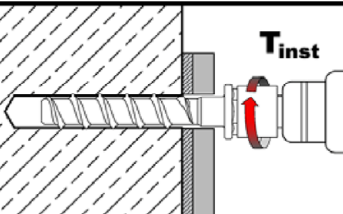
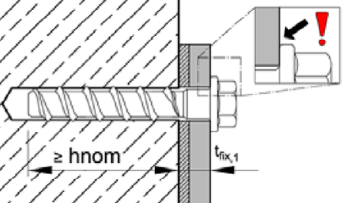
Installation instructions with filling of annular gap

Annex B4

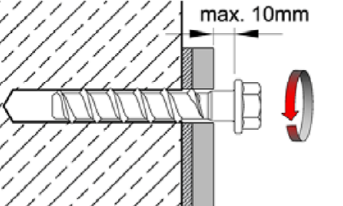
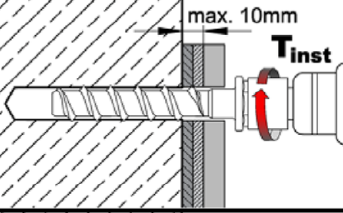
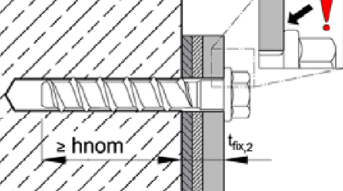
Installation instructions - Adjustment

Step 1 - 4 according to Annex B3

1. Adjustment

5		Screw may be untightened maximum 10mm.
6		After adjustment, screw in the concrete screw with tangential impact screw driver or torque wrench.
7		After installation, the head of the anchor is supported on the fixture must be undamaged.

2. Adjustment

8		Screw may be untightened maximum 10mm.
9		After adjustment, screw in the concrete screw with tangential impact screw driver or torque wrench.
10		After installation, the head of the anchor is supported on the fixture and must be undamaged.

- adjustment is permitted for fixings with concrete screws size BSZ 8 - BSZ 14, all anchorage depths
- the fastener may be adjusted max. 2x. The fastener must not be screwed back by more than 10mm in each case. The relining carried out during adjustment must not exceed 10 mm in total. Nominal embedment depth h_{nom} must still be maintained after the adjustment.

Concrete Screw BSZ

Intended use
Installation instructions - Adjustment

Annex B5

Table C1: Characteristic values for **static** or **quasi-static** loads

Anchor size			BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth		h_{nom} [mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Installation factor		γ_{inst} [-]	1,0													
Tension load																
Steel failure																
Characteristic resistance		$N_{Rk,s}$ [kN]	14		27			45			67			94		
Partial factor		$\gamma_{Ms,N}$ [-]	1,5													
Pull-out																
Characteristic resistance in concrete C20/25	cracked	$N_{Rk,p}$ [kN]	2,0	4,0	5,0	9,0	12	9,0	$\geq N^0_{Rk,c}{}^{1)}$		12	$\geq N^0_{Rk,c}{}^{1)}$		$\geq N^0_{Rk,c}{}^{1)}$		
	uncracked	$N_{Rk,p}$ [kN]	4,0	9,0	7,5	12	16	12	20	26	16					
Increasing factor for $N_{Rk,p}$		Ψ_C [-]	$\left(\frac{f_{ck}}{20}\right)^{0,5}$													
Concrete cone failure																
Effective anchorage depth		h_{ef} [mm]	31	44	35	43	52	43	60	68	50	67	80	58	79	92
Spacing		$s_{cr,N}$ [mm]	3 h_{ef}													
Edge distance		$c_{cr,N}$ [mm]	1,5 h_{ef}													
Factor k_1	cracked	$k_{cr,N}$ [-]	7,7													
	uncracked	$k_{ucr,N}$ [-]	11,0													
Splitting																
Characteristic resistance		$N^0_{Rk,sp}$ [kN]	$\min [N_{Rk,p}; N^0_{Rk,c}{}^{1)}]$													
Spacing		$s_{cr,sp}$ [mm]	120	160	120	140	150	140	180	210	150	210	240	180	240	280
Edge distance		$c_{cr,sp}$ [mm]	60	80	60	70	75	70	90	105	75	105	120	90	120	140
Shear load																
Steel failure <u>without</u> lever arm																
Characteristic resistance		$V^0_{Rk,s}$ [kN]	7,0		13,5		17,0	22,5	34,0		33,5	42,0		56,0		
Partial factor		$\gamma_{Ms,V}$ [-]	1,25													
Ductility factor		k_7 [-]	0,8													
Steel failure <u>with</u> lever arm																
Characteristic bending resistance		$M^0_{Rk,s}$ [Nm]	10,9		26			56			113			185		
Concrete pry-out failure																
Pry-out factor		k_8 [-]	1,0		1,0			1,0	2,0		1,0	2,0		1,0	2,0	
Concrete edge failure																
Effective length of anchor		$l_f = h_{ef}$ [mm]	31	44	35	43	52	43	60	68	50	67	80	58	79	92
Outside diameter of anchor		d_{nom} [mm]	6		8			10			12			14		

¹⁾ $N_{Rk,c}^0$ according to EN 1992-4:2018

Concrete Screw BSZ

Performance

Characteristic values for **static** or **quasi-static** loads

Annex C1

Table C2: Characteristic resistance for **seismic loading**, performance category **C1**

Anchor size			BSZ 6		BSZ 8	BSZ 10		BSZ 12	BSZ 14
Nominal embedment depth	h_{nom}	[mm]	40	55	65	55	85	100	115
Installation factor	γ_{inst}	[-]	1,0						
Tension load									
Steel failure									
Characteristic resistance	$N_{Rk,s,eq}$	[kN]	14		27		45	67	94
Partial factor	γ_{Ms}	[-]	1,5						
Pull-out									
Characteristic resistance	$N_{Rk,p,eq}$	[kN]	2,0	4,0	12	9,0	$\geq N_{Rk,c}^{0\ 1)}$		
Concrete cone failure									
Effective anchorage depth	h_{ef}	[mm]	31	44	52	43	68	80	92
Spacing	$s_{cr,N}$	[mm]	$3h_{ef}$						
Edge distance	$c_{cr,N}$	[mm]	$1,5h_{ef}$						
Shear load									
Steel failure <u>without</u> lever arm									
Characteristic resistance	$V_{Rk,s,eq}$	[kN]	4,7	5,5	8,5	13,5	15,3	21,0	22,4
Partial factor	γ_{Ms}	[-]	1,25						
Concrete pry-out failure									
Pry-out factor	k_8	[-]	1,0				2,0		
Concrete edge failure									
Effective length of anchor	$l_f = h_{ef}$	[mm]	31	44	52	43	68	80	92
Outside diameter of anchor	d_{nom}	[mm]	6		8	10		12	14
Factor for annular gap	<u>with</u> filling of annular gap	α_{gap}	[-]	1,0					
	<u>without</u> filling of annular gap	α_{gap}	[-]	0,5					

¹⁾ $N_{Rk,c}^0$ for concrete strength class C20/25, according to EN 1992-4:2018

Concrete Screw BSZ

Performance

Characteristic resistance for **seismic loading**, performance category **C1**

Annex C2

Table C3: Characteristic resistance for **seismic loading**, performance category **C2**,
with filling of annular gap, concrete screw BSZ zinc plated

Anchor size			BSZ 8	BSZ 10	BSZ 12	BSZ 14
Nominal embedment depth	h_{nom}	[mm]	65	85	100	115
Installation factor	γ_{inst}	[-]	1,0			
Tension load						
Steel failure						
Characteristic resistance	$N_{Rk,s,eq}$	[kN]	27	45	67	94
Partial factor	γ_{Ms}	[-]	1,5			
Pull-out						
Characteristic resistance	$N_{Rk,p,eq}$	[kN]	2,4	5,4	7,1	10,5
Concrete cone failure						
Effective anchorage depth	h_{ef}	[mm]	52	68	80	92
Spacing	$s_{cr,N}$	[mm]	$3h_{ef}$			
Edge distance	$c_{cr,N}$	[mm]	$1,5h_{ef}$			
Shear load						
Steel failure without lever arm						
Characteristic resistance	$V_{Rk,s,eq}$	[kN]	9,9	18,5	31,6	40,7
Partial factor	γ_{Ms}	[-]	1,25			
Concrete pry-out failure						
Pry-out factor	k_8	[-]	1,0	2,0		
Concrete edge failure						
Effective length of anchor	$l_f = h_{ef}$	[mm]	52	68	80	92
Outside diameter of anchor	d_{nom}	[mm]	8	10	12	14
Factor for annular gap with filling of annular gap	α_{gap}	[-]	1,0			

Concrete Screw BSZ

Performance

Characteristic resistance for **seismic loading**, performance category **C2**
with filling of annular gap

Annex C3

Table C4: Characteristic resistance for **seismic loading**, performance category **C2**, **without filling of annular gap**, concrete screw BSZ zinc plated

Anchor size			BSZ 8	BSZ 10	BSZ 12	BSZ 14	
Nominal embedment depth		h_{nom}	[mm]	65	85	100	115
Installation factor		γ_{inst}	[-]	1,0			
Tension loads							
Hexagon head	Steel failure						
	Characteristic resistance	$N_{Rk,s,eq}$	[kN]	27	45	67	94
	Partial factor	γ_{Ms}	[-]	1,5			
	Pull-out						
	Characteristic resistance	$N_{Rk,p,eq}$	[kN]	2,4	5,4	7,1	10,5
Countersunk head	Steel failure						
	Characteristic resistance	$N_{Rk,s,eq}$	[kN]	27	45	no performance assessed	
	Partial factor	γ_{Ms}	[-]	1,5			
	Pull-out						
	Characteristic resistance	$N_{Rk,p,eq}$	[kN]	2,4	5,4	no performance assessed	
Concrete cone failure							
Effective anchorage depth		h_{ef}	[mm]	52	68	80	92
Spacing		$s_{cr,N}$	[mm]	3 h_{ef}			
Edge distance		$c_{cr,N}$	[mm]	1,5 h_{ef}			
Shear loads							
Steel failure <u>without</u> lever arm							
Hexagon head	Characteristic resistance	$V_{Rk,s,eq}$	[kN]	10,3	21,9	24,4	23,3
	Partial factor	γ_{Ms}	[-]	1,25			
Counter-sunk head	Characteristic resistance	$V_{Rk,s,eq}$	[kN]	3,6	13,7	no performance assessed	
	Partial factor	γ_{Ms}	[-]	1,25			
Concrete pry-out failure							
Pry-out factor		k_8	[-]	1,0	2,0		
Concrete edge failure							
Effective length of anchor		$l_f = h_{ef}$	[mm]	52	68	80	92
Outside diameter of anchor		d_{nom}	[mm]	8	10	12	14
Factor for annular gap without filling of annular gap		α_{gap}	[-]	0,5			

Concrete Screw BSZ

Performance

Characteristic resistance for **seismic loading**, performance category **C2**
without filling of annular gap

Annex C4

Table C5: Characteristic values of resistance under **fire exposure**

Anchor size			BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14			
Nominal anchorage depth		h_{nom}	[mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Steel failure (tension and shear resistance)																	
Characteristic resistance	R30	$N_{Rk,s,fi}$ = $V_{Rk,s,fi}$	[kN]	0,9		2,4		4,4		7,3		10,3					
	R60			0,8		1,7		3,3		5,8		8,2					
	R90			0,6		1,1		2,3		4,2		5,9					
	R120			0,4		0,7		1,7		3,4		4,8					
Steel failure <u>with</u> lever arm																	
Characteristic bending resistance	R30	$M^0_{Rk,s,fi}$	[Nm]	0,7		2,4		5,9		12,3		20,4					
	R60			0,6		1,8		4,5		9,7		15,9					
	R90			0,5		1,2		3,0		7,0		11,6					
	R120			0,3		0,9		2,3		5,7		9,4					
Edge distance		$c_{cr,fi}$	[mm]	2 h_{ef}													
In case of fire attack from more than one side, the minimum edge distance shall be ≥ 300 mm																	
Spacing		$s_{cr,fi}$	[mm]	4 h_{ef}													
The characteristic resistance for pull-out $N_{Rk,p,fi}$, concrete cone failure $N^0_{Rk,c,fi}$, concrete pry-out $V_{Rk,cp,fi}$ and concrete edge failure $V^0_{Rk,c,fi}$ shall be calculated according to EN 1992-4:2018.																	
The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given values																	

Concrete Screw BSZ

Performance
Characteristic values of resistance under **fire exposure**

Annex C5

Table C6: Displacements under static or quasi-static loads

Anchor size			BSZ 6		BSZ 8			BSZ 10			BSZ 12			BSZ 14		
Nominal embedment depth	h_{nom}	[mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115
Tension load																
cracked concrete	Tension load	N [kN]	0,95	1,9	2,4	4,3	5,7	4,3	7,9	9,6	5,7	9,4	12,3	7,6	12,0	15,1
	Displacement	δ_{N0} [mm]	0,3	0,6	0,6	0,7	0,8	0,6	0,5	0,9	0,9	0,5	1,0	0,5	0,8	0,7
		$\delta_{N\infty}$ [mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2	1,2	1,0	1,2	1,2	0,9	1,2	1,0
uncracked concrete	Tension load	N [kN]	1,9	4,3	3,6	5,7	7,6	5,7	9,5	11,9	7,6	13,2	17,2	10,6	16,9	21,2
	Displacement	δ_{N0} [mm]	0,4	0,6	0,7	0,9	0,5	0,7	1,1	1,0	1,0	1,1	1,2	0,9	1,2	0,8
		$\delta_{N\infty}$ [mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2	1,2	1,0	1,2	1,2	0,9	1,2	1,0
Shear load																
	Shear load	V [kN]	3,3		8,6			16,2			20,0			30,5		
	Displacement	δ_{V0} [mm]	1,55		2,7			2,7			4,0			3,1		
		$\delta_{V\infty}$ [mm]	3,1		4,1			4,3			6,0			4,7		

Concrete Screw BSZ

Performance
Displacements under static or quasi-static loads

Annex C6

Table C7: Displacements under **seismic loading**, performance category **C2**
with filling of annular gap, concrete screw BSZ zinc plated

Anchor size			BSZ 8	BSZ 10	BSZ 12	BSZ 14
Nominal embedment depth	h_{nom}	[mm]	65	85	100	115
Tension load						
Displacement DLS	$\delta_{N,eq(DLS)}$	[mm]	0,66	0,32	0,57	1,16
Displacement ULS	$\delta_{N,eq(ULS)}$	[mm]	1,74	1,36	2,36	4,39
Shear load						
Displacement DLS	$\delta_{V,eq(DLS)}$	[mm]	1,68	2,91	1,88	2,42
Displacement ULS	$\delta_{V,eq(ULS)}$	[mm]	5,19	6,72	5,37	9,27

Table C8: Displacements under **seismic loading**, performance category **C2**
without filling of annular gap, concrete screw BSZ zinc plated

Anchor size			BSZ 8	BSZ 10	BSZ 12	BSZ 14
Nominal embedment depth	h_{nom}	[mm]	65	85	100	115
Tension load						
Type with hexagon head						
Displacement DLS	$\delta_{N,eq(DLS)}$	[mm]	0,66	0,32	0,57	1,16
Displacement ULS	$\delta_{N,eq(ULS)}$	[mm]	1,74	1,36	2,36	4,39
Type with countersunk head						
Displacement DLS	$\delta_{N,eq(DLS)}$	[mm]	0,66	0,32	-	-
Displacement ULS	$\delta_{N,eq(ULS)}$	[mm]	1,74	1,36	-	-
Shear load						
Type with hexagon head						
Displacement DLS	$\delta_{V,eq(DLS)}$	[mm]	4,21	4,71	4,42	5,60
Displacement ULS	$\delta_{V,eq(ULS)}$	[mm]	7,13	8,83	6,95	12,63
Type with countersunk head						
Displacement DLS	$\delta_{V,eq(DLS)}$	[mm]	2,51	2,98	-	-
Displacement ULS	$\delta_{V,eq(ULS)}$	[mm]	7,76	6,25	-	-

Concrete Screw BSZ

Performance
Displacements under **seismic loading**, performance category **C2**

Annex C7